

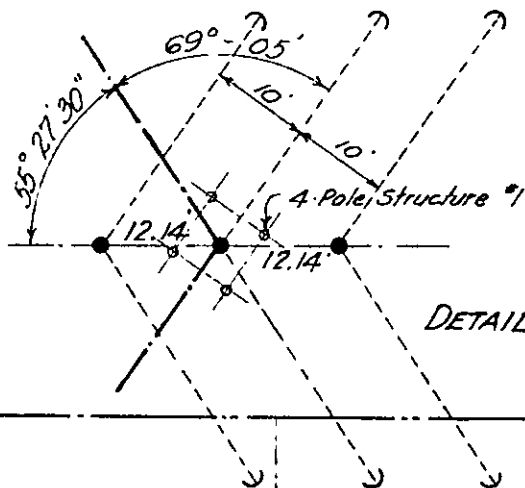


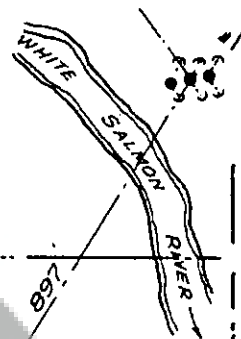

Replace #1 - (4 Pole Structure) with 3-Pole Structure


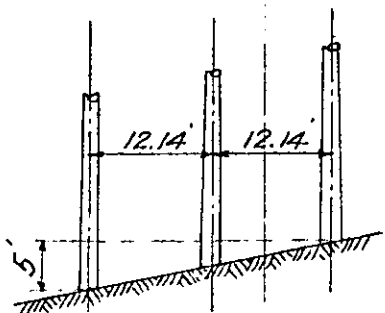


Replace #2 with 3-40 10' Centers

ANGLE - 74°-45'

#3 - Replace with 2-40, 7' Centers (Stakes are set on 10' centers)

W.P. 1. am

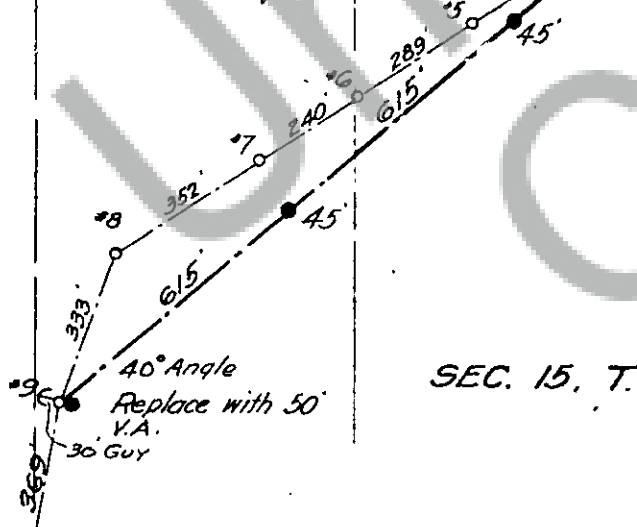

SEC. 15, T.9N. R.10E. W.M.

APPROVED D. N. Aaron ENGINEER

DRAWN	<u>(Signature)</u>	7-17-45
TRACED		
CHECKED		
CORRECTED		
APPROVED		

CONDIT 66 K.V. REVISION
FROM POLE #1 TO #9

NORTHWESTERN ELECTRIC COMPANY,
PORTLAND, OREGON.

SCALE 1"=400' DATE _____

APPROVED _____ CHIEF ENGINEER.

PNA-1981

REVISED